



Centre for Fire Research
Van Mourik Broekmanweg 6
P.O. Box 49
2600 AA Delft

TNO report

**EN 13823:2002 "Single Burning Item" and EN
11925-2:2002 "Ignitability" test report of
examination on the reaction to fire performance of
particle board treated with Envirograf Product 92**

www.tno.nl

T +31 15 276 30 00
F +31 15 276 30 25

Date	June 2006
Author(s)	F. Paap W. Langstraat
Number of pages	9 including graphs and pictures
Sponsor	Environmental Seals Ltd Envirograf House Barfrestone, DOVER Kent, CT15 7JG United Kingdom
Project name	Reaction to Fire
Project number	006.55494/01.01

All rights reserved.

No part of this publication may be reproduced and/or published by print, photoprint, microfilm or any other means without the previous written consent of TNO.

In case this report was drafted on instructions, the rights and obligations of contracting parties are subject to either the Standard Conditions for Research Instructions given to TNO, or the relevant agreement concluded between the contracting parties. Submitting the report for inspection to parties who have a direct interest is permitted.

© 2006 TNO

Contents

1	Introduction	3
----------	---------------------------	----------

1 Introduction

Products: 12 mm standard wood particle board, coated with two coats of Product 92 - ES/VFR at 10 m² per litre.

Purpose of test:

Examination of product name on reaction to fire performance and smoke production in accordance with EN 13823: 2002 – Single Burning Item (SBI).

Contractor, manufacturer and production site:

Environmental Seals Ltd
 Envirograf House
 Barfrestone, DOVER
 Kent, CT15 7JG
 United Kingdom

Dates of examination: 31 May, 2006

Period of report issue and report number:

2006; **2006-CVB-R0????**.

Product description: 12 mm standard wood particle board, coated with two coats of Product 92 - ES/VFR at 10 m² per litre.

Mounting configuration:

The product was mounted on a softwood frame against a wooden particle board substrate with an air gap of 40 mm. A horizontal joint was positioned at 500 mm from the bottom of the specimen, a vertical joint was positioned at 200 mm from the corner.

Samples:

Sampling procedure: by contractor

Age: At time of examination: unknown

Date of receipt: 18 April, 2006

Between receipt and testing the samples were conditioned at 23 °C and 50 % r.h.

Examination:

A total of three SBI test were carried out.

Table 1: SBI classification parameter results.

Product ref. and test no.	Heat production / flame spread				Smoke production		Flaming debris	
	FIGRA _{0.2MJ} [W/s]	FIGRA _{0.4MJ} [W/s]	THR _{600s} [MJ]	LFS _{edge} {Y/N}	SMOGRA [m ² /s ²]	TSP _{600s} [m ²]	FDP _{f≤10s} {Y/N}	FDP _{f>10s} {Y/N}
	23	22	3.5	N	0	11	N	N
	90	90	7.5	N	0	10	N	N
	22	22	3.6	N	0	14	N	N
Values used for Classification	45	45	4.9	N	0	12	N	N

Observations during the tests: none

Remark: the smoke production was calculated using the data from a separate run as reference level, as agreed upon in the SH02 of Notified Bodies, on April 10 2006, in Paris.

Ignitability following EN 11925-2:2002

The results are given in Table 2.

Table 2: Ignitability classification parameter results, ignition time 30 s

sample	Ignition of sample	Maximum flame height	t ₁₅₀	After-burning time	Ignition of filter paper
	[Y/N]	[mm]	[s]	[s]	Y/N
Edge ignition					
1	Y		∞ not reached	0	N
2	Y			0	N
3	Y			0	N
4	Y			0	N
5	Y			0	N
6	Y			0	N
Value used for classification					N
surface ignition					
1	Y		∞ not reached	0	N
2	Y			0	N
3	Y			0	N
4	Y			0	N
5	Y			0	N
6	Y			0	N
Value used for classification					N

Observations of physical behaviour of the test specimen: the material did not shrink and melt away from the flame without ignition. Applying the testing protocol as specified in Annex A of the standard was therefore deemed not necessary.

Conclusions/Remarks:

1. A formal classification is to be assessed in accordance with the EN 13501-1, "Classification using fire reaction tests".

2. The field of application of the test results is limited to the end use applications in accordance with the mounting and fixing used in the test.
3. Graphs of rate of heat release $HRR_{av}(t)$, total heat release $THR(t)$, $1000 \cdot HRR_{av}(t)/(t-300)$, rate of smoke production $SPR_{av}(t)$, total smoke production $TSP(t)$ and $10000 \cdot SPR_{av}(t)/(t-300)$, are presented hereafter.
4. The test results relate to the behaviour of the test specimens of a material under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the material in use.
5. Regarding the precision of the test method, the following information is given in the Annex B of the EN 13823:

Table B.2 — Average relative standard deviations

	FIGRA _{0,2MJ}	FIGRA _{0,4MJ}	THR _{600s}	SMOGRA	TSP _{600s}
Average (s _r /m)	14 %	15 %	11 %	15 %	18 %

Following Annex B of EN 11925-2 the absolute repeatability/reproducibility for this test method is within 3 s to 5 s.

W. Langstraat

F. Paap Ph.D.

EN 13823 (SBI test)

TNO
 data processing

Productname: **Envirograf product 92 ES/FER**

Testdate: 31 May 2006

Specimen no: 1 of 3

Preliminary SBI classification: **A1-B / s1 / d0**


(Final classification assessment is based on repetitive SBI tests and other tests)

Classification parameter results:


FIGRA _{0.2MJ} [W/s]:	23	LFS till edge {Y/N}:	N
FIGRA _{0.4MJ} [W/s]:	22	FDP (f<10s) {Y/N}:	N
THR _{600s} [MJ]:	3.5	FDP (f>10s) {Y/N}:	N
SMOGRA [m ² /s ²]:	0		
TSP _{600s} [m ²]:	11		

Checks OK {Y/N}: Y

HRR_{av}(t) and THR(t)

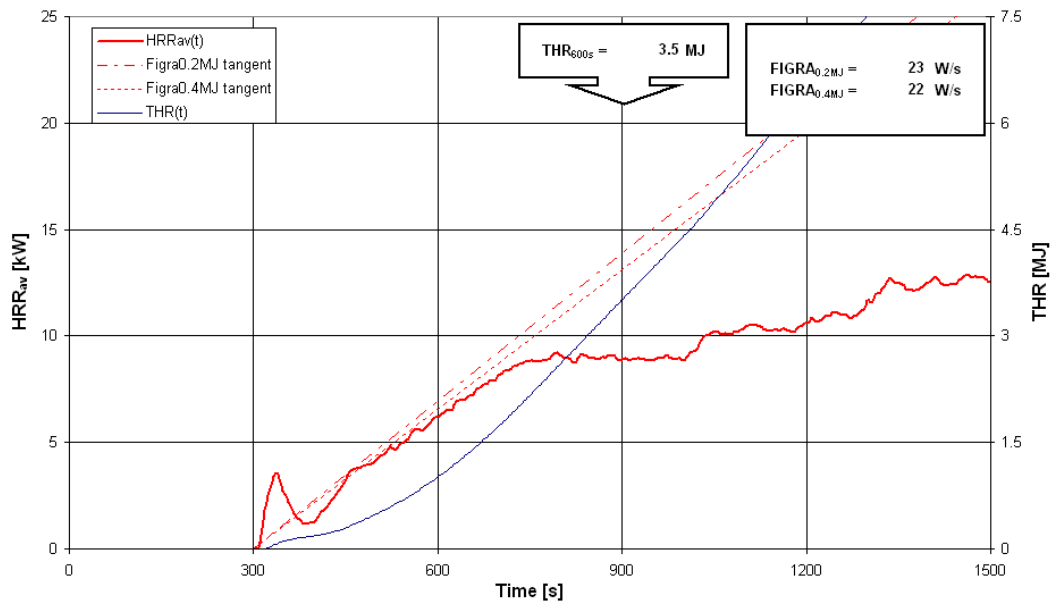

SPR_{av}(t) and TSP(t)

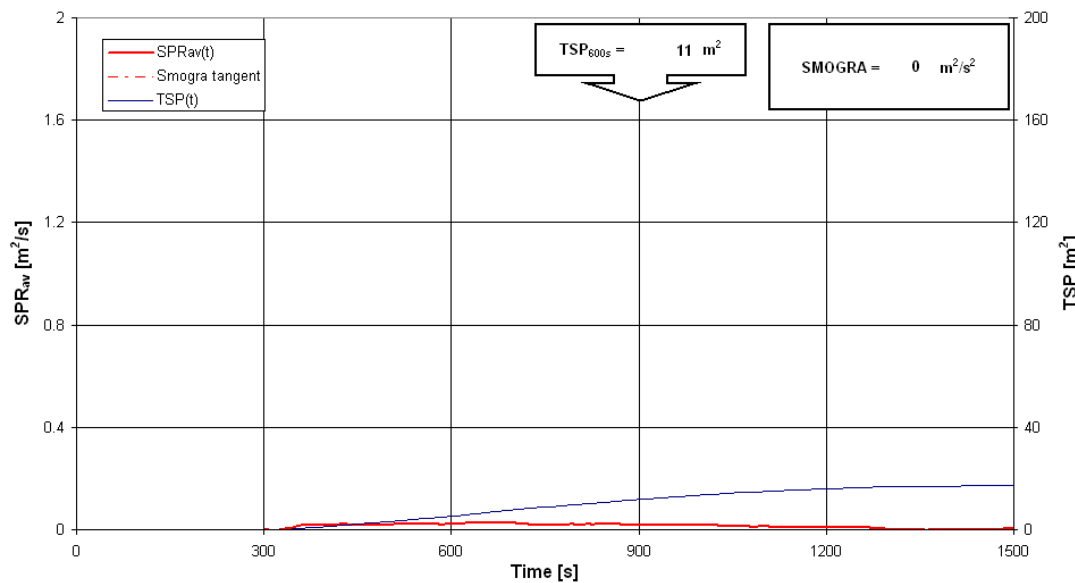

EN 13823 (SBI test)


TNO
 data processing

Productname: **Envirograf product 92 ES/FER**


Testdate: 31 May 2006


Specimen no: 1 of 3

FIGRA with thresholds

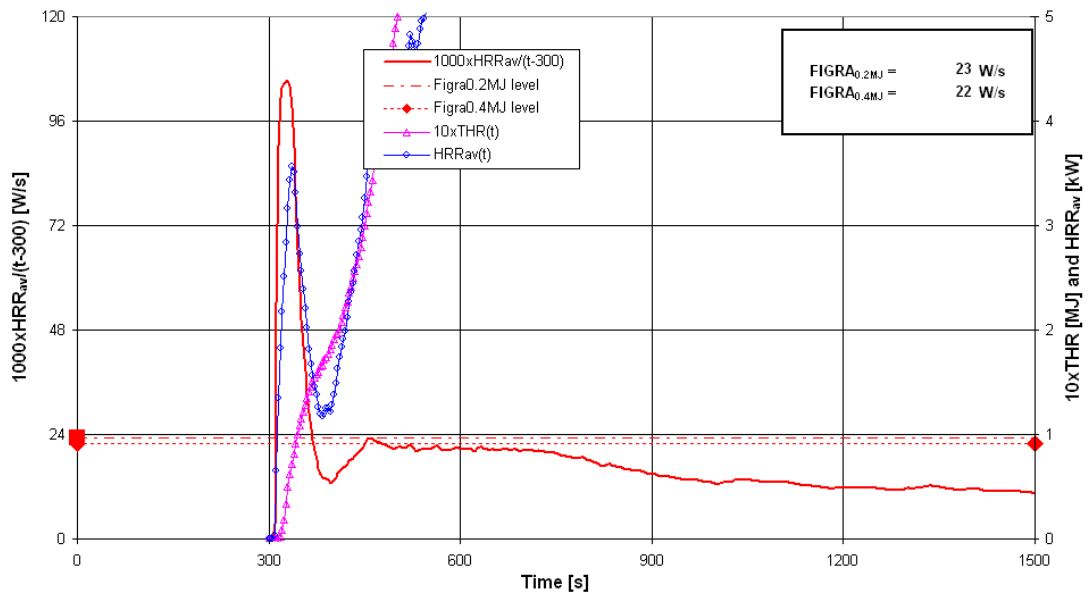

SMOGRA with thresholds

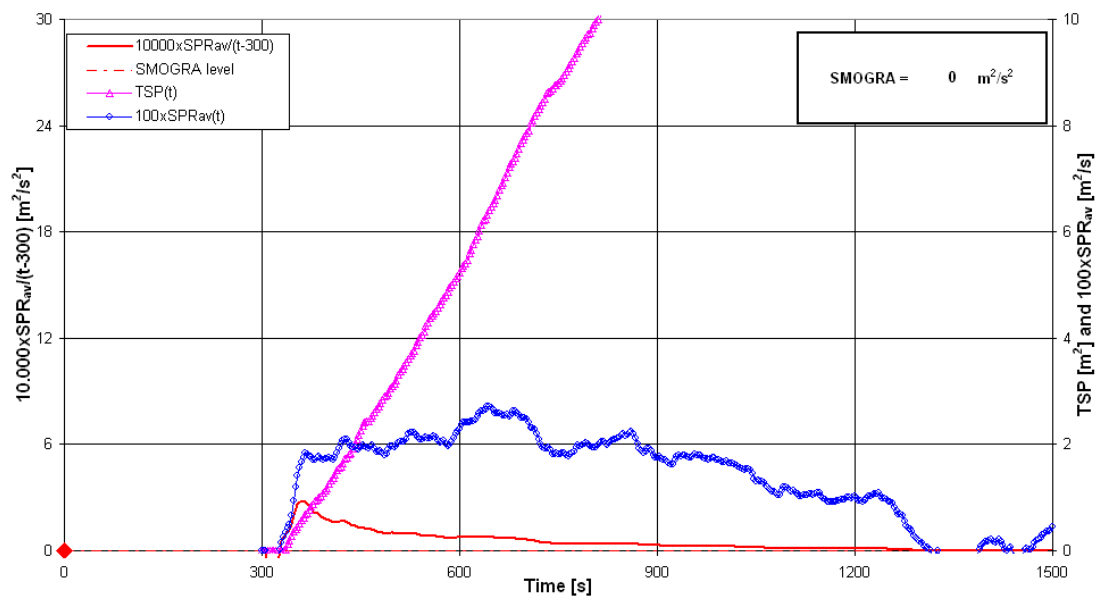

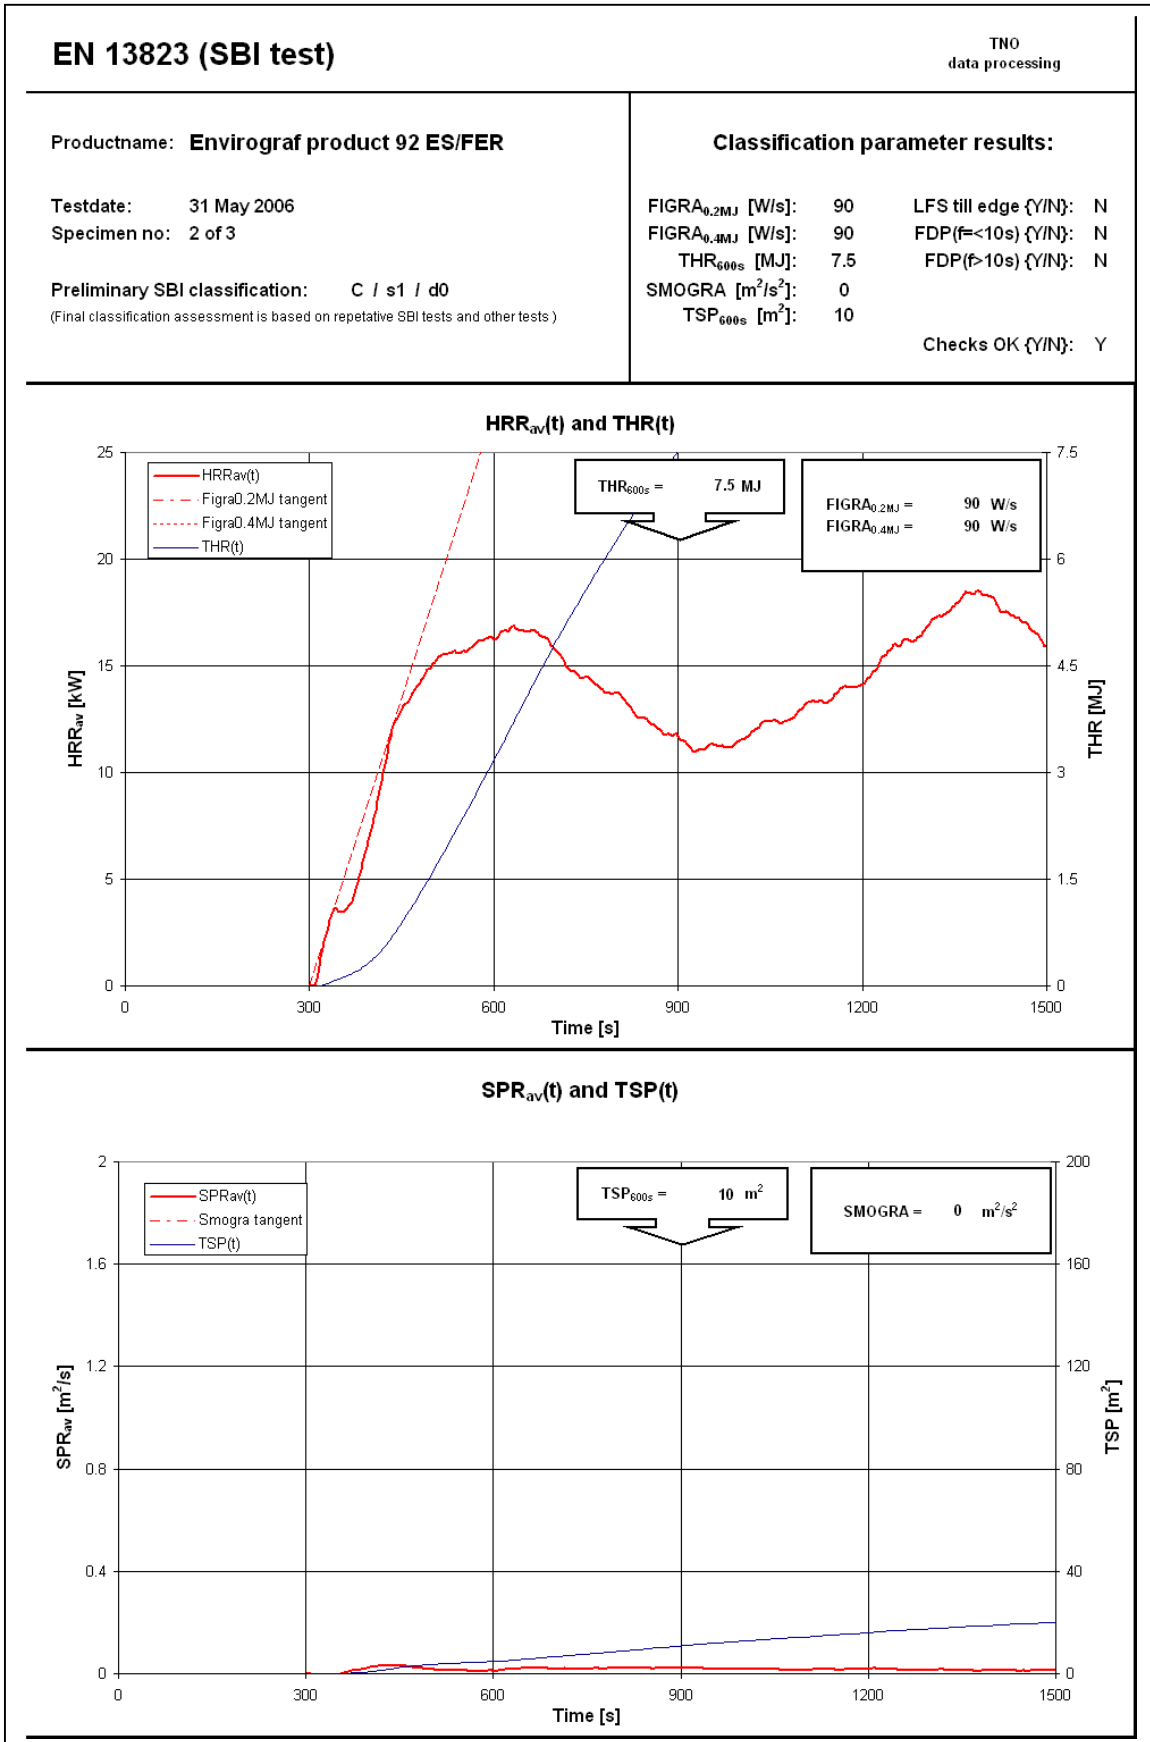

EN 13823 (SBI test)


TNO
 data processing

Productname: **Envirograf product 92 ES/FER**


Testdate: 31 May 2006

Specimen no: 2 of 3

FIGRA with thresholds

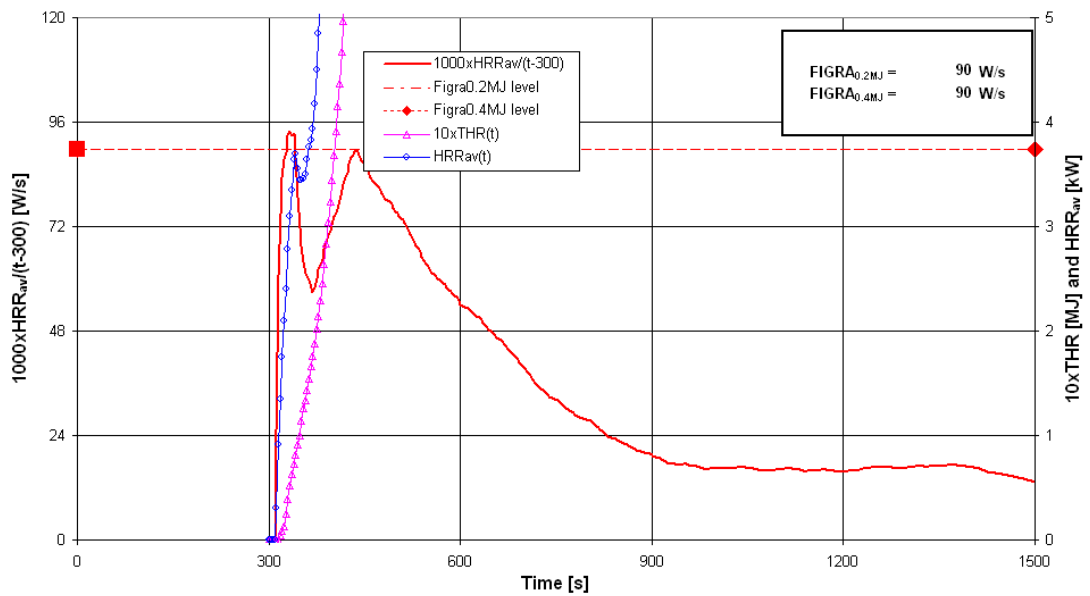

SMOGRA with thresholds

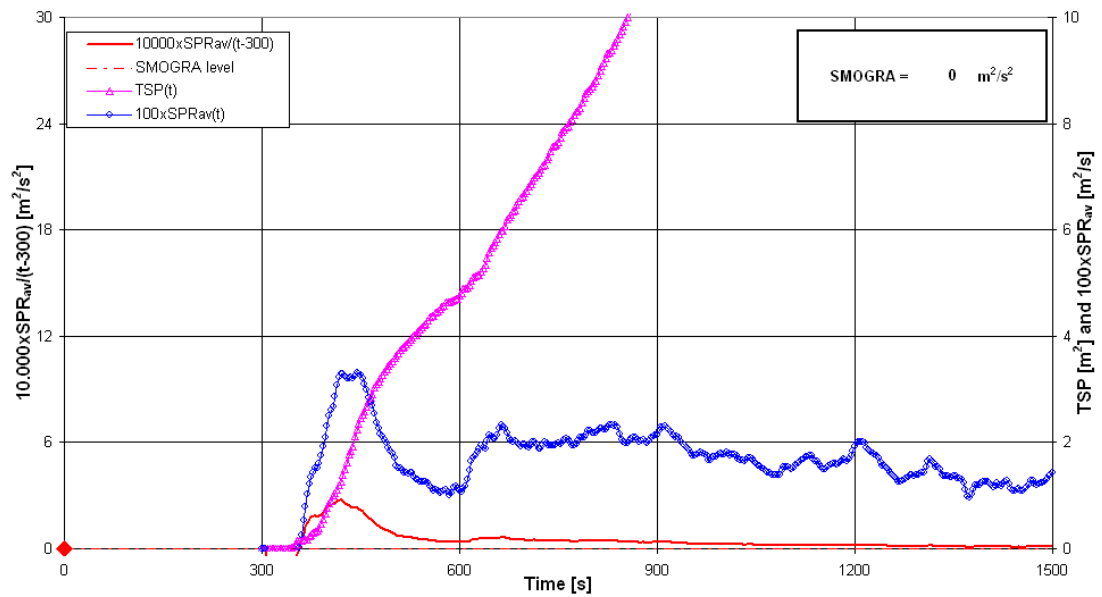

EN 13823 (SBI test)

TNO
 data processing

Productname: **Envirograf product 92 ES/FER**

Testdate: 31 May 2006

Specimen no: 3 of 3

Preliminary SBI classification: **A1-B / s1 / d0**


(Final classification assessment is based on repetitive SBI tests and other tests)

Classification parameter results:


FIGRA _{0,2MJ} [W/s]:	22	LFS till edge {Y/N}:	N
FIGRA _{0,4MJ} [W/s]:	22	FDP($f < 10s$) {Y/N}:	N
THR _{600s} [MJ]:	3.6	FDP($f > 10s$) {Y/N}:	N
SMOGRA [m ² /s ²):	0		
TSP _{600s} [m ²):	14		

Checks OK {Y/N}: Y

HRR_{av}(t) and THR(t)

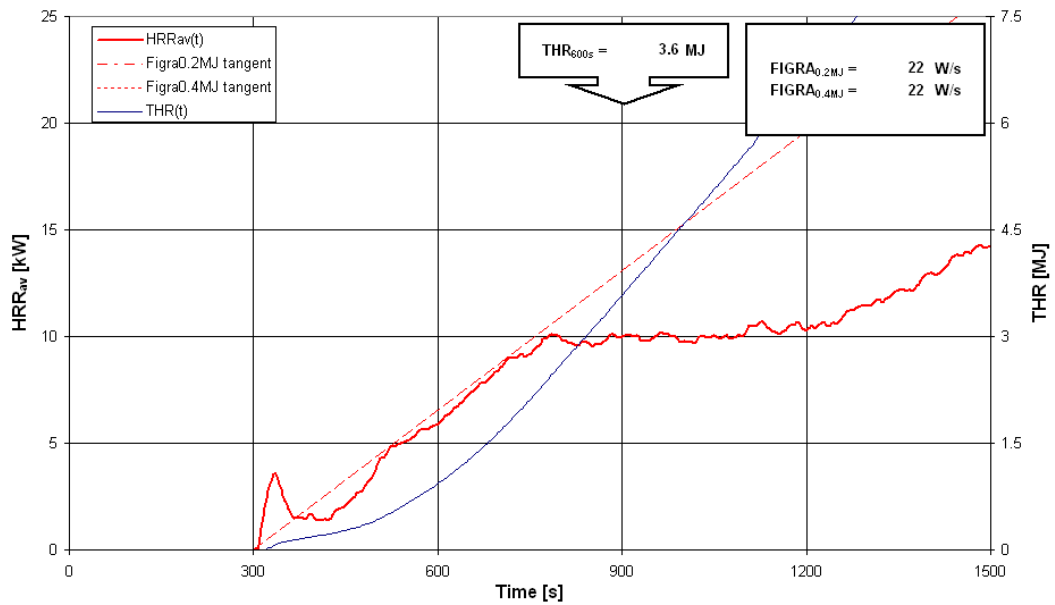

SPR_{av}(t) and TSP(t)

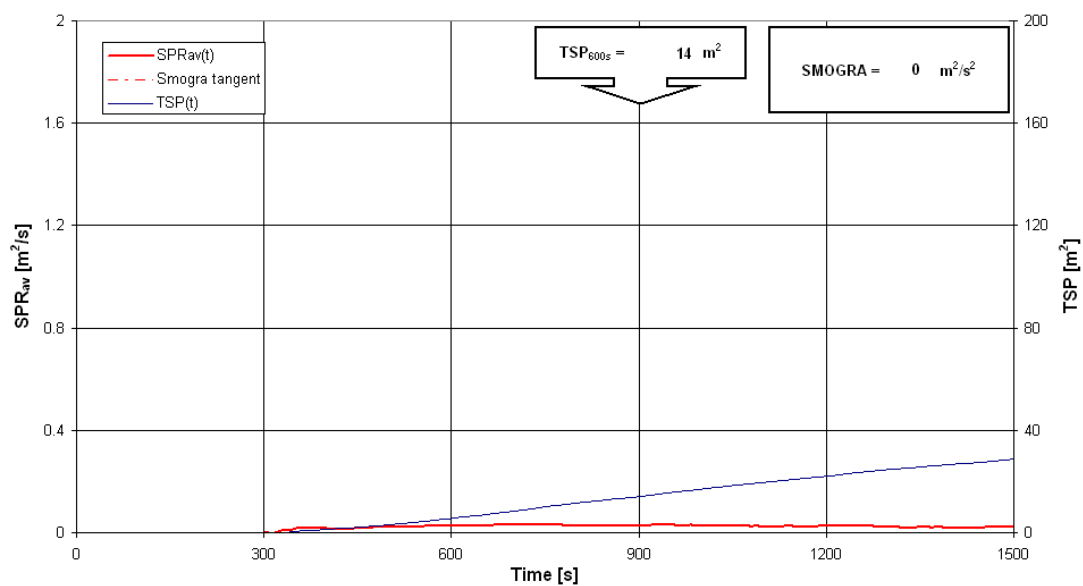

EN 13823 (SBI test)


TNO
 data processing

Productname: **Envirograf product 92 ES/FER**


Testdate: 31 May 2006

Specimen no: 3 of 3

FIGRA with thresholds

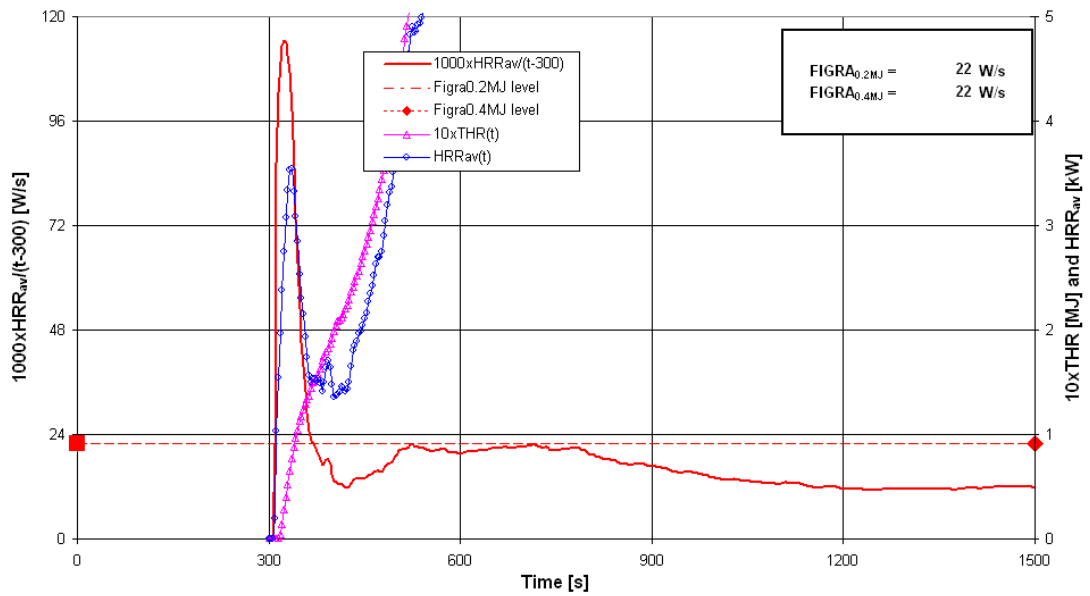

SMOGRA with thresholds

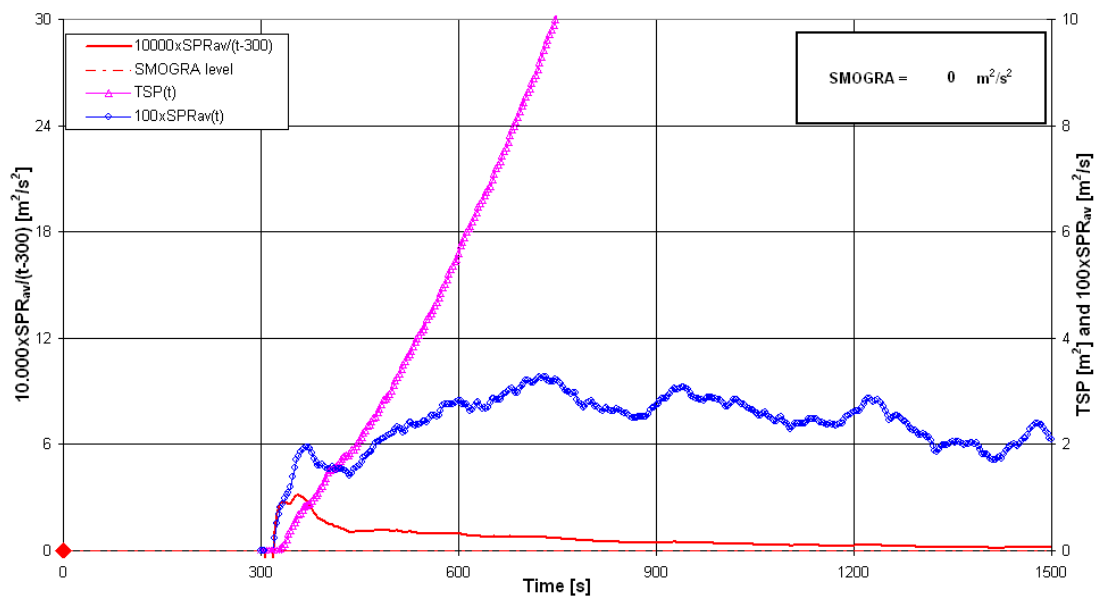

Pictures of the test specimen before and after the test.